




Pool/Spa Closures (2016-2019) Report


The Environmental Health Department monitors and regulates the toxicity, pollution, and quality of things that affect the public through the environment including: water and air quality, hazardous or toxic waste, food, and housing. The following report focuses on recreational pool/spa closures in San Joaquin County from 2016 through the end of 2019.

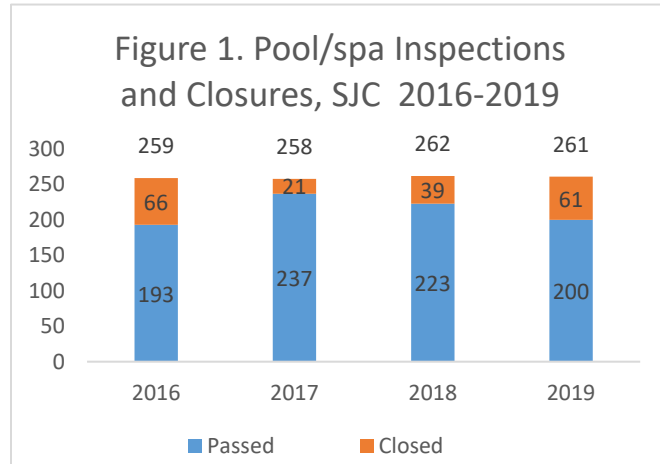

Of the 1040 routine pool/spa inspections in between 2016 and 2019, there were 187 closures (18%). There was a decrease in closures in both 2017 and 2018 but the number of closures increased again in 2019 (Figure 1).

While the number of closures was lower in 2018 the average length of closure was much longer than other years at 11 days (Figure 2).

The overall average length of closure was 6.4 days between 2016-2019 with a median of 2 days and a maximum of 90 days.

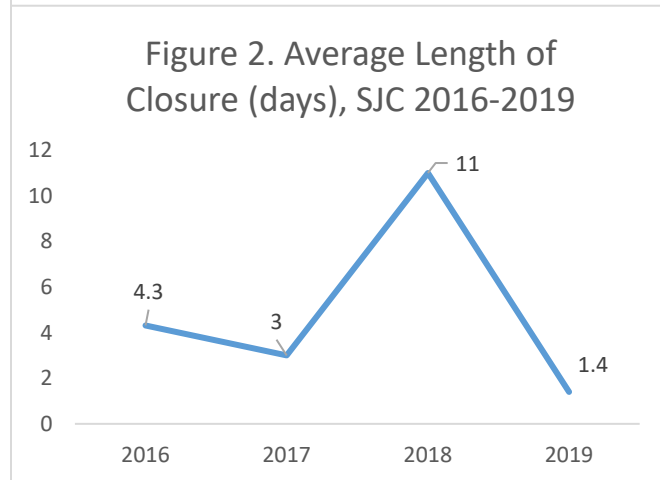


While citations happen for a variety of reasons, chemical violations (insufficient chlorine, high pH, etc.) were 3.75 times more common than physical violations (broken gate, non-functional light, etc.) during this time period (Figure 3). High or low chlorine concentration were the most frequent violations, followed by high or low pH.

Over the 4 year period, 90 pool/spas were closed just one time, 31 pool/spas were closed twice, 10 pool/spas were closed three times, and 1 pool/spa was closed four times.

Pool/spas that were closed multiple times did not often have the same issues from year to year.

Additionally, many pool/spas were closed for more than one issue when they were closed; for example: low chlorine, high pH, and a broken gate.

It is clear that certain years have fewer violations than others in San Joaquin County. These variations may be due to changes in weather or changes in safety compliance.

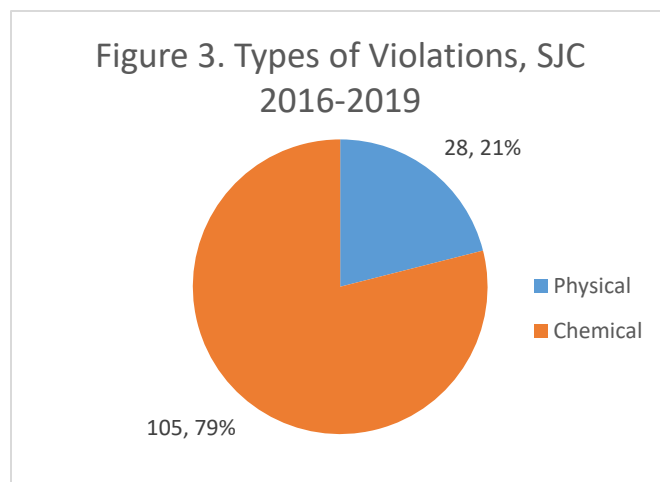

Environmental Health Department

Pool and Spa Closures 2016-2019

Name	Site Address	Record ID	Activity Date	Service	Program/Element	Comments
ALMONDWOOD EST HOA	800 AZALEA ST	PR0360305	8/7/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected. Pool reopened.
AMERICAN INN	550 W CHARTER WAY	PR0360021	6/24/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Facility was closed due to chlorine levels being less than 1.0 PPM chlorine.
AMERICAN INN	550 W CHARTER WAY	PR0360021	7/29/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed for low pH
AMERICAN INN	550 W CHARTER WAY	PR0360021	6/24/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Violation corrected, facility is operational again.
AMERICAN INN	550 W CHARTER WAY	PR0360021	7/29/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened
AMERICA'S BEST VALUE INN	1920 E YOSEMITE AVE	PR0506638	7/3/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to reopen pool
ASPIRE APARTMENT HOMES	2725 PAVILION PKWY	PR0541519	7/30/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened at 2:15pm - Major violations corrected.
AVALON PLACE APARTMENTS	198 NORTHGATE DR	PR0360099	7/19/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high free chlorine and high pH.
AVALON PLACE APARTMENTS	198 NORTHGATE DR	PR0360099	7/19/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	OK to re-open pool at 12:13pm. Free chlorine and pH levels are within range.
BAUM, JAMES W	471 ALMOND DR	PR0360304	7/17/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is reopened after the major violations are corrected.
BECKMAN ESTATES HOA	771 BRANDYWINE DR	PR0360007	8/1/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed
BEST WESTERN HOTEL	811 W CLOVER RD	PR0503954	7/25/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened at 11:05am
BIRCHES APARTMENTS	8003 N EL DORADO ST	PR0360348	6/14/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
BIRCHES APARTMENTS	8003 N EL DORADO ST	PR0360348	6/16/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
BRIDLE PATH APTS	1619 E BRIDLE PATH PL	PR0360614	7/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	spa closed
BROOKSIDE CROSSING APTS (PHASE I)	5322 FEATHER RIVER DR	PR0360011	8/18/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED
BROOKSIDE CROSSING APTS (PHASE I)	5322 FEATHER RIVER DR	PR0360011	7/30/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-inspection of chlorine levels. Chlorine at acceptable level, 9.8ppm, pool re-opened.
BROOKSIDE CROSSING APTS (PHASE I)	5322 FEATHER RIVER DR	PR0360011	8/18/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	RE-OPEN POOL

BROOKSIDE CROSSING APTS (PHASE II)	5301 FEATHER RIVER DR	PR0360043	8/18/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED
BROOKSIDE CROSSING APTS (PHASE II)	5301 FEATHER RIVER DR	PR0360043	8/18/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	RE-OPEN POOL
BUDGET INN & SUITES OF STOCKTON	3473 W HAMMER LN	PR0360575	6/14/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
BUDGET INN & SUITES OF STOCKTON	3473 W HAMMER LN	PR0360575	6/16/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
BUDGET INN & SUITES OF STOCKTON	3473 W HAMMER LN	PR0360575	7/28/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
CALIFORNIA INN	4100 E WATERLOO RD	PR0360089	7/3/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Major violation corrected.
CAMBRIDGE COURT APTS	6507 DANNY DR	PR0507152	8/18/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool is reopened.
CAMBRIDGE PLACE COA	445 ALMOND DR	PR0360012	8/1/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed
CAMBRIDGE PLACE COA	445 ALMOND DR	PR0360012	7/16/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is re opened after provide a life ring complying with code.
CAMBRIDGE PLACE COA	445 ALMOND DR	PR0360012	8/4/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pOOL reopens
CAPTAINS COVE APTS	349 S UNION RD	PR0360506	6/28/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED at 1:30 pm (high free chlorine and high pH).
CAPTAINS COVE APTS	349 S UNION RD	PR0360506	6/28/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool at 4:10pm. Free chlorine and pH are within the appropriate range.
CEDAR CREEK PROPERTIES LP	9430 WESTMORA CT	PR0360327	8/3/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed.
CEDAR CREEK PROPERTIES LP	9430 WESTMORA CT	PR0360327	8/2/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is reopened after major violations are corrected. pH is now 7.2 and free chlorine is 5.2 ppm.
CEDAR CREEK PROPERTIES LP	9430 WESTMORA CT	PR0360327	8/5/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool reopens
CEDAR SQUARE COA	1414 PAJARO AVE	PR0360018	6/30/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED - high free chlorine.
CEDAR SQUARE COA	1414 PAJARO AVE	PR0360018	7/21/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low pH.
CEDAR SQUARE COA	1414 PAJARO AVE	PR0360018	7/21/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened. Pool pH is now within range.

CEDAR SQUARE COA	1414 PAJARO AVE	PR0360018	6/30/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED
CHATEAU APARTMENTS LODI	200 W TURNER RD	PR0360023	7/18/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Reopened Pool
CLAREMONT GARDEN APARTMENTS	820 N LOWER SACRAMENTO RD	PR0360329	8/25/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed
CLAREMONT GARDEN APARTMENTS	820 N LOWER SACRAMENTO RD	PR0360329	8/25/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
CLIPPER COVE APARTMENT	7611 LIGHTHOUSE DR	PR0360025	8/14/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Received an email from the pool operator showing that light had been repaired. I told him that is ok to re-open the pool.
COLONIAL PLAZA APARTMENTS	8295 KELLEY DR A	PR0360609	7/20/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
COLONIAL PLAZA APARTMENTS	8295 KELLEY DR A	PR0360609	8/5/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
COMFORT INN	14730 S HARLAN RD	PR0516548	7/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool has had levels of pH lowered to 7.4. Pool is permitted for re-opening.
COUNTRY MANOR MOBILE ESTATES	17251 N TRETHERWAY RD	PR0360334	6/11/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closure due to no free chlorine and high pH.
COUNTRY MANOR MOBILE ESTATES	17251 N TRETHERWAY RD	PR0360334	6/12/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is re opened after correcting the major violations.
COURTYARD BY MARRIOTT	3252 W MARCH LN	PR0507199	6/13/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high chlorine level
COURTYARD BY MARRIOTT	3252 W MARCH LN	PR0507199	6/14/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool and spa reopened
DAYS INN	4219 E WATERLOO RD	PR0360138	6/26/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Major violations observed at the main pool. Pool is closed till violations are corrected.
DELTA GARDEN APARTMENT	1123 W SWAIN RD	PR0360438	8/15/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-inspection for low chlorine. Chlorine levels were observed to be at 8.4ppm at the time of re-inspection and the pool is ok to be opened.
DELTA QUAIL APARTMENTS	1919 QUAIL LAKES DR	PR0360032	8/8/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool water tested fine. Re-opened.
DELTA VIEW APARTMENTS 1 LLC	802 W WEBER AVE	PR0360034	7/3/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed due to low pH
DELTA VIEW APARTMENTS 1 LLC	802 W WEBER AVE	PR0360034	7/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Chlorine level is now acceptable. Pool re-opened
DELTA VIEW APARTMENTS 1 LLC	802 W WEBER AVE	PR0360034	7/5/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to reopen pool
EASTWOOD MANOR COA	146 E GRANT LINE RD	PR0360346	7/15/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Received picture in a text of a new rope on the life ring. Ok to re-open. See file.

ECONO STUDIOS	4540 N EL DORADO ST	PR0360055	6/8/2017	001 - ROUTINE INSPECTION - Operating Permit	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed. OIR emailed to psluthra@gmail.com and justswimmy2@gmail.com
EL RANCHO MOBILEHOME PARK	1830 E YOSEMITE AVE	PR0360038	7/20/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED. No chlorine in pool.
EL RANCHO MOBILEHOME PARK	1830 E YOSEMITE AVE	PR0360038	7/25/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	RE-OPEN pool.
EVERGREEN GARDENS APARTMENTS	1305 EL MONTE ST	PR0360354	6/8/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to lack of safety equipment and high free chlorine
EVERGREEN GARDENS APARTMENTS	1305 EL MONTE ST	PR0360354	6/20/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to re-open pool
FAIRFIELD INN	2410 NAGLEE RD	PR0515193	8/2/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool
FAIRFIELD INN	2410 NAGLEE RD	PR0515193	8/2/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-inspection at regulated pool. Spa closed 7-30-19. OK to re-open given at 10:25am. Remaining minor violations: railing is wobbly, combined chlorine is 1.0ppm, CYA is greater than 100ppm, pool records need to be maintained, and the pool need to be vacuumed. Inspection report e-mailed to dorine
FRENCH CAMP RV PARK LLC	3919 E FRENCH CAMP RD	PR0506211	8/1/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed for cloudy pool and low chlorine
FRENCH CAMP RV PARK LLC	3919 E FRENCH CAMP RD	PR0506211	7/8/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violations corrected, chlorine levels have risen to 2.0 PPM.
FRENCH CAMP RV PARK LLC	3919 E FRENCH CAMP RD	PR0506211	8/3/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED pH has been adjusted to 7.6.
HAMPTON INN & SUITES	103 E LOUISE AVE	PR0526184	7/29/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is permitted to be reopened.
HAMPTON INN & SUITES LODI	1337 S BECKMAN RD	PR0528205	6/4/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is closed due to major violations detected and to be corrected.
HAMPTON INN & SUITES LODI	1337 S BECKMAN RD	PR0528205	6/5/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	All major and minor violations had been corrected. Pool is re opened.
HARBOR ISLE APARTMENTS	8429 MARINERS DR	PR0360367	7/22/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
HARBOR ISLE APARTMENTS	8429 MARINERS DR	PR0360367	7/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
HARVEST GOLD LP - VILLA DE ORO	39 GATEWAY CT	PR0360502	6/14/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3612 - PUBLIC POOL/SPA - ADDITIONAL	pool closed
HARVEST GOLD LP - VILLA DE ORO	39 GATEWAY CT	PR0360301	6/14/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed

HARVEST GOLD LP - VILLA DE ORO	39 GATEWAY CT	PR0360301	6/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool reopens
HOLIDAY INN EXPRESS	5045 S HWY 99	PR0518087	6/25/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closure for the pool due to the pH being higher than 8.0.
HOLIDAY INN EXPRESS	5045 S HWY 99	PR0518087	6/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Facility was re-opened after violations have been corrected and pH had been stabilized to 7.6.
HOLIDAY INN EXPRESS HOTEL & SUITES	179 COMMERCE AVE	PR0522085	6/25/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high chlorine and high pH.
HOLIDAY INN EXPRESS HOTEL & SUITES	179 COMMERCE AVE	PR0522085	6/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened (major violations corrected)
IN SHAPE CITY - STOCKTON	7920 KELLEY DR	PR0508070	7/23/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Reopened Pool
IN SHAPE HEALTH CLUB - WEST LANE	1074 E BIANCHI RD	PR0360182	6/17/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is closed due to major violation detected.
IN SHAPE HEALTH CLUB - WEST LANE	1074 E BIANCHI RD	PR0360182	6/18/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Main pool is re opened after major violations corrected.
IRON HORSE APARTMENTS	2506 COUNTRY CLUB BLVD	PR0360339	6/2/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high chlorine and high pH
IRON HORSE APARTMENTS	2506 COUNTRY CLUB BLVD	PR0360339	6/5/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool re-opened
JUNIPER APARTMENTS	1201 E ATHERTON DR	PR0537295	6/22/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED - free chlorine is 0.2 ppm
JUNIPER APARTMENTS	1201 E ATHERTON DR	PR0537295	6/23/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool this date.
LA QUINTA MOTOR INN #625	2710 W MARCH LN	PR0360065	6/17/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high chlorine
LA QUINTA MOTOR INN #625	2710 W MARCH LN	PR0360065	6/14/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low pH
LA QUINTA MOTOR INN #625	2710 W MARCH LN	PR0360065	6/19/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to zero chlorine, low pH, and water cloudy
LA QUINTA MOTOR INN #625	2710 W MARCH LN	PR0360065	6/21/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to reopen pool
LA QUINTA MOTOR INN #625	2710 W MARCH LN	PR0360065	6/16/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
LAKESHORE MEADOWS APTS SOUTH	2080 SYLVAN WAY	PR0360560	6/8/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed pH 8.0.

LAKESHORE MEADOWS APTS SOUTH	2080 SYLVAN WAY	PR0360560	6/16/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool.
LAMPLITER	1426 TELEGRAPH AVE APT 1	PR0360383	6/6/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low chlorine level.
LAMPLITER	1426 TELEGRAPH AVE APT 1	PR0360383	6/9/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
LAUREL GLEN APARTMENTS	574 BUTTON AVE	PR0360066	6/10/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected
LINCOLN COURTYARD	443 GLENDORA AVE	PR0360419	6/14/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low pH
LINCOLN COURTYARD	443 GLENDORA AVE	PR0360419	6/15/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to re-open pool
LINCOLN COURTYARD	531 GLENDORA AVE	PR0360384	6/14/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to gate not latching, hook not attached to a pole ,and low chlorine.
LINCOLN COURTYARD	531 GLENDORA AVE	PR0360384	6/13/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool re-opened
MARINERS COVE APARTMENTS	8531 MARINERS DR	PR0360083	7/1/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool.
MEADOWGREEN APARTMENTS	211 W SAN CARLOS WAY	PR0360084	6/20/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low pH and zero free chlorine
MEADOWGREEN APARTMENTS	211 W SAN CARLOS WAY	PR0360084	7/11/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low pH
MEADOWGREEN APARTMENTS	211 W SAN CARLOS WAY	PR0360084	7/10/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed due to low ph and one drain cover semi out of place
MEADOWGREEN APARTMENTS	211 W SAN CARLOS WAY	PR0360084	6/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	OK to reopen pool. Chlorine and pH levels are now acceptable.
MEADOWGREEN APARTMENTS	211 W SAN CARLOS WAY	PR0360084	7/13/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
MICROTEL INN & SUITES	861 W CLOVER RD	PR0527869	6/21/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool Closed
MICROTEL INN & SUITES	861 W CLOVER RD	PR0527869	8/1/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened at 1:45pm
MICROTEL INN & SUITES	861 W CLOVER RD	PR0527869	6/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-open pool.
MOTEL 6	2654 W MARCH LN	PR0360565	6/20/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to gate not closing and no life ring.

MOTEL 6	2654 W MARCH LN	PR0360565	6/26/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed-gate not self latching, zero chlorine, low pH, and cloudy water
MOTEL 6	2654 W MARCH LN	PR0360565	7/15/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Chlorine and pH level now acceptable.
MOTEL 6 #1323	6717 PLYMOUTH RD	PR0360001	6/28/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed due to high ph and free chlorine.
MUSD-EAST UNION HIGH SCHOOL	1700 N UNION ST	PR0360572	8/4/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3616 - PUBLIC POOL/SPA - EXEMPT	Pool closed due to high chlorine and high pH.
NORTHGATE COMMONS APARTMENTS	510 NORTHGATE DR	PR0360095	8/3/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED
NORTHGATE COMMONS APARTMENTS	510 NORTHGATE DR	PR0360095	8/3/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED
NORTHGATE MANOR APARTMENTS	360 NORTHGATE DR	PR0360096	6/19/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low chlorine.
NORTHGATE MANOR APARTMENTS	360 NORTHGATE DR	PR0360096	6/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Chlorine at 4.4 ppm.
NORTHGATE TOWERS APARTMENTS	470 NORTHGATE DR	PR0360094	6/19/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low chlorine.
NORTHGATE TOWERS APARTMENTS	470 NORTHGATE DR	PR0360094	6/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Chlorine at 6.0 ppm.
OAKWOOD SHORES OWNERS ASSOCIATION	1699 BELLA LAGO WAY	PR0535460	6/21/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed (pH too high, chlorine too low)
OAKWOOD SHORES OWNERS ASSOCIATION	1699 BELLA LAGO WAY	PR0535460	6/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened (major violations corrected)
ORCHARD RV PARK	2701 E HWY 132	PR0360010	8/15/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened at 10:25am
ORCHARD RV PARK	2701 E HWY 132	PR0360010	7/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool
ORCHARD RV PARK	2701 E HWY 132	PR0360010	9/9/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Ok to re-open.
PACIFIC HEIGHTS VILLAS	126 E JAMESTOWN ST	PR0360493	8/15/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool reopened.
PACIFIC PALMS APARTMENTS	4415 N PERSHING AVE	PR0360417	6/10/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high free chlorine
PACIFIC PALMS APARTMENTS	4415 N PERSHING AVE	PR0360417	6/11/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Ok to reopen pool

PACIFIC VILLAS LP	4550 SHELLEY CT	PR0360408	9/28/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool reopens
PACIFIC VILLAS LP	4550 SHELLEY CT	PR0360408	7/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool (remains) closed.
PARADISE APARTMENTS	1441 PARKER AVE	PR0360424	8/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened. Major violations corrected.
PARK PLACE APARTMENTS	1257 CROM ST	PR0360563	6/27/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to faulty light fixture
PARK PLACE APARTMENTS	1257 CROM ST	PR0360563	6/28/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected.
PASEO VILLAS APTS	801 E ATHERTON DR	PR0524195	6/7/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Major violations (pH and chlorine)
PASEO VILLAS APTS	801 E ATHERTON DR	PR0524195	6/7/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violations corrected
PINEWOOD COVE COA	3219 DE OVAN AVE	PR0360433	6/22/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed due to high chlorine
PINEWOOD COVE COA	3219 DE OVAN AVE	PR0360433	6/27/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to re-open pool
PLYMOUTH BAY APARTMENTS	6723 PLYMOUTH RD	PR0360108	7/11/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Free chlorine and pH were verified. Ok to reopen the pool.
POINT QUEST EDUCATION	12755 N HWY 88	PR0360311	6/6/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed. See OIR
POINT QUEST EDUCATION	12755 N HWY 88	PR0360311	6/20/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopens
POLO RUN APARTMENTS	8162 PALISADES DR	PR0360184	8/31/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool.
POOL HOA, THE	131 S ALLEN DR	PR0360435	8/24/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed
POOL HOA, THE	131 S ALLEN DR	PR0360435	8/24/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool opens
QUALITY INN & SUITES	16855 S HARLAN RD	PR0506103	8/2/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool has pH balance to 7.2 and free chlorine to 7.0 ppm. Pool is permitted to be reopened.
QUINCY GARDENS APARTMENTS	221 QUINCY ST	PR0360125	6/29/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed
QUINCY GARDENS APARTMENTS	221 QUINCY ST	PR0360125	7/1/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool was reopened
RED ROOF INN	1707 W FREMONT ST	PR0360046	6/21/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed

RED ROOF INN	1707 W FREMONT ST	PR0360046	6/23/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool was re-opened
REGENCY CONDOMINIUM ASSN	2421 COUNTRY CLUB BLVD	PR0360524	6/8/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3612 - PUBLIC POOL/SPA - ADDITIONAL	Pool closed. Water was green and pH was low
RESIDENCE INN BY MARRIOT	3240 W MARCH LN	PR0507211	6/17/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to low chlorine
RESIDENCES AT BROOKSIDE	3939 N PERSHING AVE	PR0360313	6/17/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due low chlorine
RESIDENCES AT BROOKSIDE	3939 N PERSHING AVE	PR0360313	6/28/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened
RESIDENCES AT BROOKSIDE	3939 N PERSHING AVE	PR0360313	6/15/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to re-open pool
RIPON GARDEN APTS	1663 N RIPON RD	PR0544736	8/15/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violations corrected. reopen pool
RIVERBANK APARTMENTS POOL	4433 CONTINENTAL WAY	PR0360119	7/26/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is re opened as major violation is corrected. Free chlorine is 7ppm.
RIVERBANK APARTMENTS POOL	4433 CONTINENTAL WAY	PR0360119	6/24/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopens
RIVERS EDGE	505 PIONEER DR	PR0360107	6/9/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is reopened
ROSELAWN APARTMENTS	1835 ROSELAWN AVE	PR0360441	6/26/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	ok to re-open pool
SAHARA MOBILE COURT	2340 SANGUINETTI LN	PR0360123	6/15/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened.
SCHOONER LANDING APARTMENTS	7100 SHORELINE DR	PR0360552	7/29/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	pool reopen
SIENNA PLACE APARTMENTS	794 BUTTON AVE	PR0360405	6/21/2019	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to high chlorine and lack of life ring.
SIENNA PLACE APARTMENTS	794 BUTTON AVE	PR0360405	6/24/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED. Free chlorine level is above limit.
SIENNA PLACE APARTMENTS	794 BUTTON AVE	PR0360405	6/25/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Major violations corrected.
SIENNA PLACE APARTMENTS	794 BUTTON AVE	PR0360405	6/24/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED. Free chlorine level is now between 2.0 and 10.0 ppm.
SOUTHLAND MOBILE HOME PARK	1624 N HWY 99	PR0360132	8/28/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Major violation corrected.
SPRING CREEK COUNTRY CLUB	1580 E SPRING CREEK DR	PR0360451	8/7/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected. Reopened pool.
STOCKTON TOWNHOUSE APARTMENTS	1540 TELEGRAPH AVE	PR0360455	7/15/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Free chlorine now acceptable.

STOCKTON VERDE MOBILE HOME PRK	4900 N HWY 99	PR0360139	6/23/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopens
STONETREE CONDOMINIUMS	1819 S CHEROKEE LN	PR0360140	9/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool is reopened after fixing the sand filter.
STONEWOOD HOMEOWNERS ASSN	8704 STONEWOOD DR	PR0360529	7/13/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3612 - PUBLIC POOL/SPA - ADDITIONAL	Pool closed.
SUTTER APARTMENTS	430 SUTTER ST	PR0360465	8/17/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to no chlorine, high pH and the pump is not turned on.
SUTTER APARTMENTS	430 SUTTER ST	PR0360465	8/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected. pool reopened
TIENDA PLACE HOMEOWNERS ASSOC	1352 LAKESHORE DR	PR0523177	8/25/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
TORCELLO APARTMENTS	1633 BIANCHI A3	PR0518496	6/7/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	pool closed see OIR
TRACY PARK APARTMENTS	2800 N TRACY BLVD	PR0360152	8/9/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
TRACY PARK APARTMENTS	2800 N TRACY BLVD	PR0360152	8/2/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened.
UNION COURT APARTMENTS	940 S UNION RD	PR0360326	8/9/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED.
UNION COURT APARTMENTS	940 S UNION RD	PR0360326	8/11/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	RE-OPENED POOL
UOP - TOWNHOUSE APARTMENTS	4030 N PERSHING AVE	PR0360536	7/11/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to non functional pump , low chlorine and low pH.
UOP - TOWNHOUSE APARTMENTS	4030 N PERSHING AVE	PR0360536	6/24/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened
UOP - TOWNHOUSE APARTMENTS	4030 N PERSHING AVE	PR0360536	7/14/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
VALVERDE APARTMENTS	633 E STEWART ST	PR0360160	8/3/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED
VALVERDE APARTMENTS	633 E STEWART ST	PR0360160	8/9/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed: no chlorine and electrical hazard.
VALVERDE APARTMENTS	633 E STEWART ST	PR0360160	8/11/2017	335 - REINSPECTION (Actual Time)	3611 - PUBLIC POOL/SPA - PRIMARY	Pool Closed no one to open pool for re inspection at 633E Stewart St, Manteca. appointment taken for Monday 08/14/17 at 10.00am
VALVERDE APARTMENTS	633 E STEWART ST	PR0360160	8/14/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	OK to re-open the pool. Major violations corrected.

VALVERDE APARTMENTS	633 E STEWART ST	PR0360160	8/3/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED
VENETIAN BRIDGES APTS EAST	2101 ROSEMARIE LN	PR0360276	7/8/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed
VENETIAN BRIDGES APTS EAST	2101 ROSEMARIE LN	PR0360162	7/8/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3612 - PUBLIC POOL/SPA - ADDITIONAL	Pool closed
VENETIAN BRIDGES APTS EAST	2101 ROSEMARIE LN	PR0360276	7/14/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
VENETIAN BRIDGES APTS WEST	2317 ROSEMARIE LN	PR0360278	7/8/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed
VENETIAN BRIDGES APTS WEST	2317 ROSEMARIE LN	PR0360278	7/14/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
VENETIAN PARK APARTMENTS	1540 MOSAIC WAY	PR0360274	8/16/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3612 - PUBLIC POOL/SPA - ADDITIONAL	POOL CLOSED
VENETIAN PARK APARTMENTS	1540 MOSAIC WAY	PR0360161	6/25/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened
VILLA COURT APARTMENTS	1222 S HUTCHINS ST	PR0360485	8/19/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
VILLA COURT APARTMENTS	1222 S HUTCHINS ST	PR0360485	8/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
VILLAGIO APARTMENTS	550 SANDY LN	PR0528055	8/4/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED
VILLAGIO APARTMENTS	550 SANDY LN	PR0528055	7/31/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected. Reopen pool
VILLAGIO APARTMENTS	550 SANDY LN	PR0528055	8/5/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	RE-OPENED POOL
VINTAGE MANOR APARTMENTS	164 FRONTAGE RD	PR0360490	8/6/2015	002 - ROUTINE SUPPLEMENTAL ACTIVITY - Operating Permit	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed on 8-5-15. Called facility to see if they were ready to re-open. Per Mark Keson, Manager, the pool is still closed and he will call me tomorrow.
VINTAGE MANOR APARTMENTS	164 FRONTAGE RD	PR0360490	8/1/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED
VINTAGE MANOR APARTMENTS	164 FRONTAGE RD	PR0360490	7/19/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened. Major violations corrected (pH lowered and light put back into place).
VINTAGE MANOR APARTMENTS	164 FRONTAGE RD	PR0360490	8/4/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED
VINTAGE SQUARE APTS	1176 ROSEMARIE LN	PR0360100	6/22/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to damaged fence

VINTAGE SQUARE APTS	1176 ROSEMARIE LN	PR0360100	6/22/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened
WESTPOINTE APARTMENTS NE SPA	6465 N WEST LN	PR0360595	7/8/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re opened.
WESTPOINTE APARTMENTS NE SPA	6465 N WEST LN	PR0360595	9/23/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopens
WESTPOINTE APARTMENTS SE POOL	6465 N WEST LN	PR0360578	7/8/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool reopened.
WESTWOOD VILLAGE APARTMENTS	1212 W CENTER ST	PR0360185	6/30/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed due to an potential safety hazard (grounding wire sparked thus causing the pool pump and filter to shut off). OK to re-open pool when service person visits facility and gets the pump up and running again.
WESTWOOD VILLAGE APARTMENTS	1212 W CENTER ST	PR0360185	6/30/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	OK to re-open pool. Received call from Danielle Dewing (Community Director) at 4:15pm. The pool pump and filter are up and running.
WINTERS GLEN APTS / ROBERT AVE APTS	145 ROBERT AVE	PR0360612	7/25/2017	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed at 1:15pm. High chlorine and low pH.
WINTERS GLEN APTS / ROBERT AVE APTS	145 ROBERT AVE	PR0360612	7/28/2017	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Re-opened pool at 10:50 am.
WOODBIDGE GOLF & COUNTRY CLUB	800 E WOODBRIDGE RD	PR0360498	8/2/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
WOODBIDGE GOLF & COUNTRY CLUB	800 E WOODBRIDGE RD	PR0360498	8/2/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Pool re-opened.
WOODBIDGE VILLAGE CONDOMINIUM	18644 LILAC ST	PR0360188	8/2/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	Pool closed.
WOODBIDGE VILLAGE CONDOMINIUM	18644 LILAC ST	PR0360188	7/18/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Reopened Pool
YOSEMITE APARTMENTS	141 S EL PORTAL AVE	PR0360501	7/11/2019	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	Major violation corrected. Ok to reopen pool.
YOSEMITE ARMS APARTMENTS	1161 E YOSEMITE AVE	PR0360500	6/24/2016	064 - FACILITY CLOSURE NOTICE ISSUED - HEALTH HAZARD	3611 - PUBLIC POOL/SPA - PRIMARY	POOL CLOSED. Free chlorine level is above limit.
YOSEMITE ARMS APARTMENTS	1161 E YOSEMITE AVE	PR0360500	6/24/2016	063 - FACILITY REOPENED	3611 - PUBLIC POOL/SPA - PRIMARY	POOL RE-OPENED. Free chlorine level is now between 2.0 to 10.0 ppm.